


*murphy construction*

Well Yield Test Data Rockcreek Firehall Water Well 1-92  
Rockcreek , Yukon

Time Test Started: Aug. 1, 1992 11:00AM


Time (min)	Flow (igpm)	DTW (m)	Total Flow	Drawdown (m)
0	10.3	1.75	0	
1	10.1	2.5	10	-0.75
2	10.2	2.535	20	-0.785
3	10.3	2.55	31	-0.8
4	10.2	2.56	41	-0.81
6	10.2	2.565	61	-0.815
8	10.2	2.565	82	-0.815
10	10.3	2.565	102	-0.815
13	10.3	2.565	133	-0.815
16	10.1	2.575	164	-0.825
20	10.2	2.58	204	-0.83
25	10.3	2.585	256	-0.835
32	10.4	2.59	328	-0.84
40	10.5	2.59	410	-0.84
50	10.5	2.59	514	-0.84
64	10.4	2.59	658	-0.84
80	10.5	2.595	824	-0.845
100	10.5	2.595	1031	-0.845
120	10.6	2.595	1239	-0.845
150	10.4	2.595	1549	-0.845
180	10.5	2.595	1860	-0.845
210	10.5	2.6	2172	-0.85
240	10.5	2.6	2483	-0.85
300	10.5	2.6	3107	-0.85
360	10.5	2.6	3735	-0.85

# ROCKCREEK FIREHALL WELL TEST

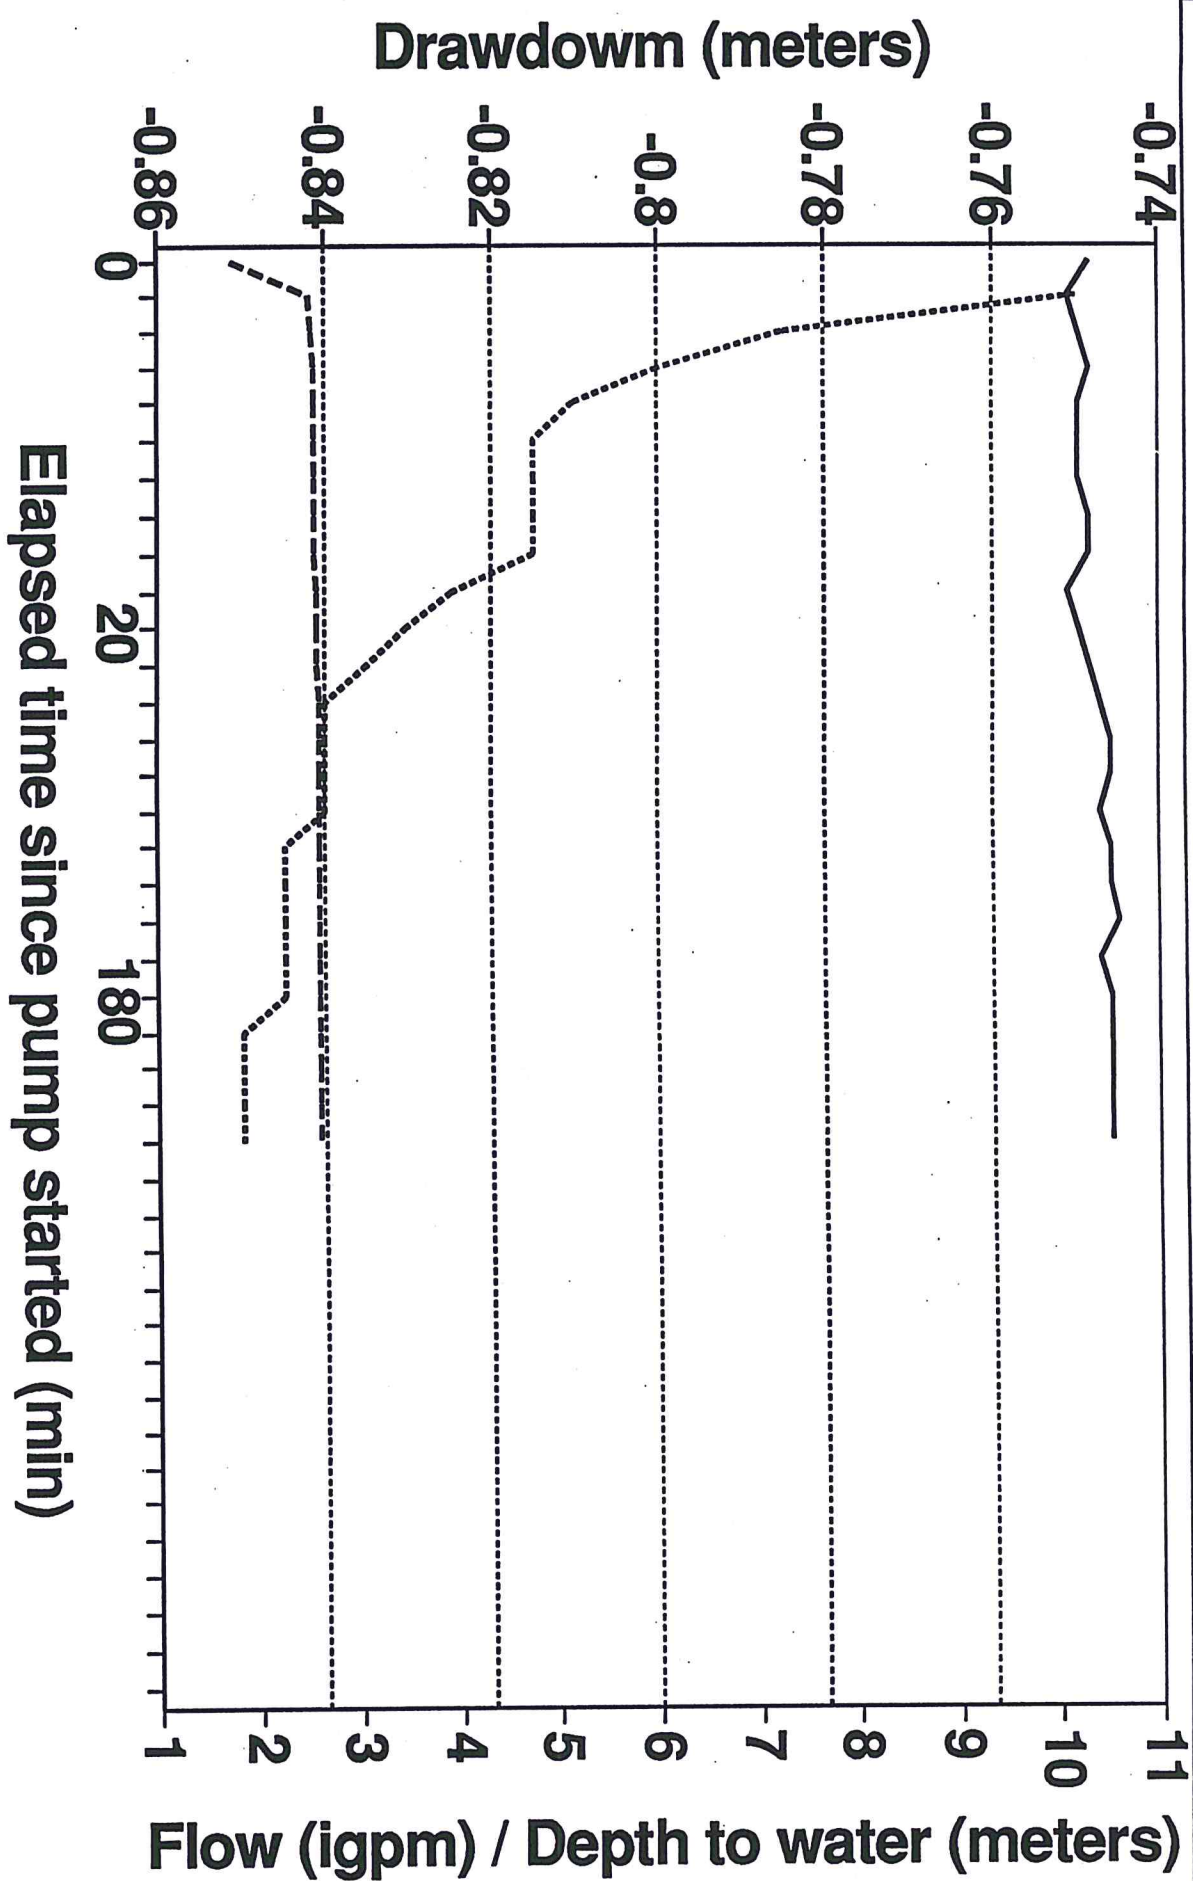

Drawdown (meters)

-0.74  
-0.76  
-0.78  
-0.8  
-0.82  
-0.84  
-0.86

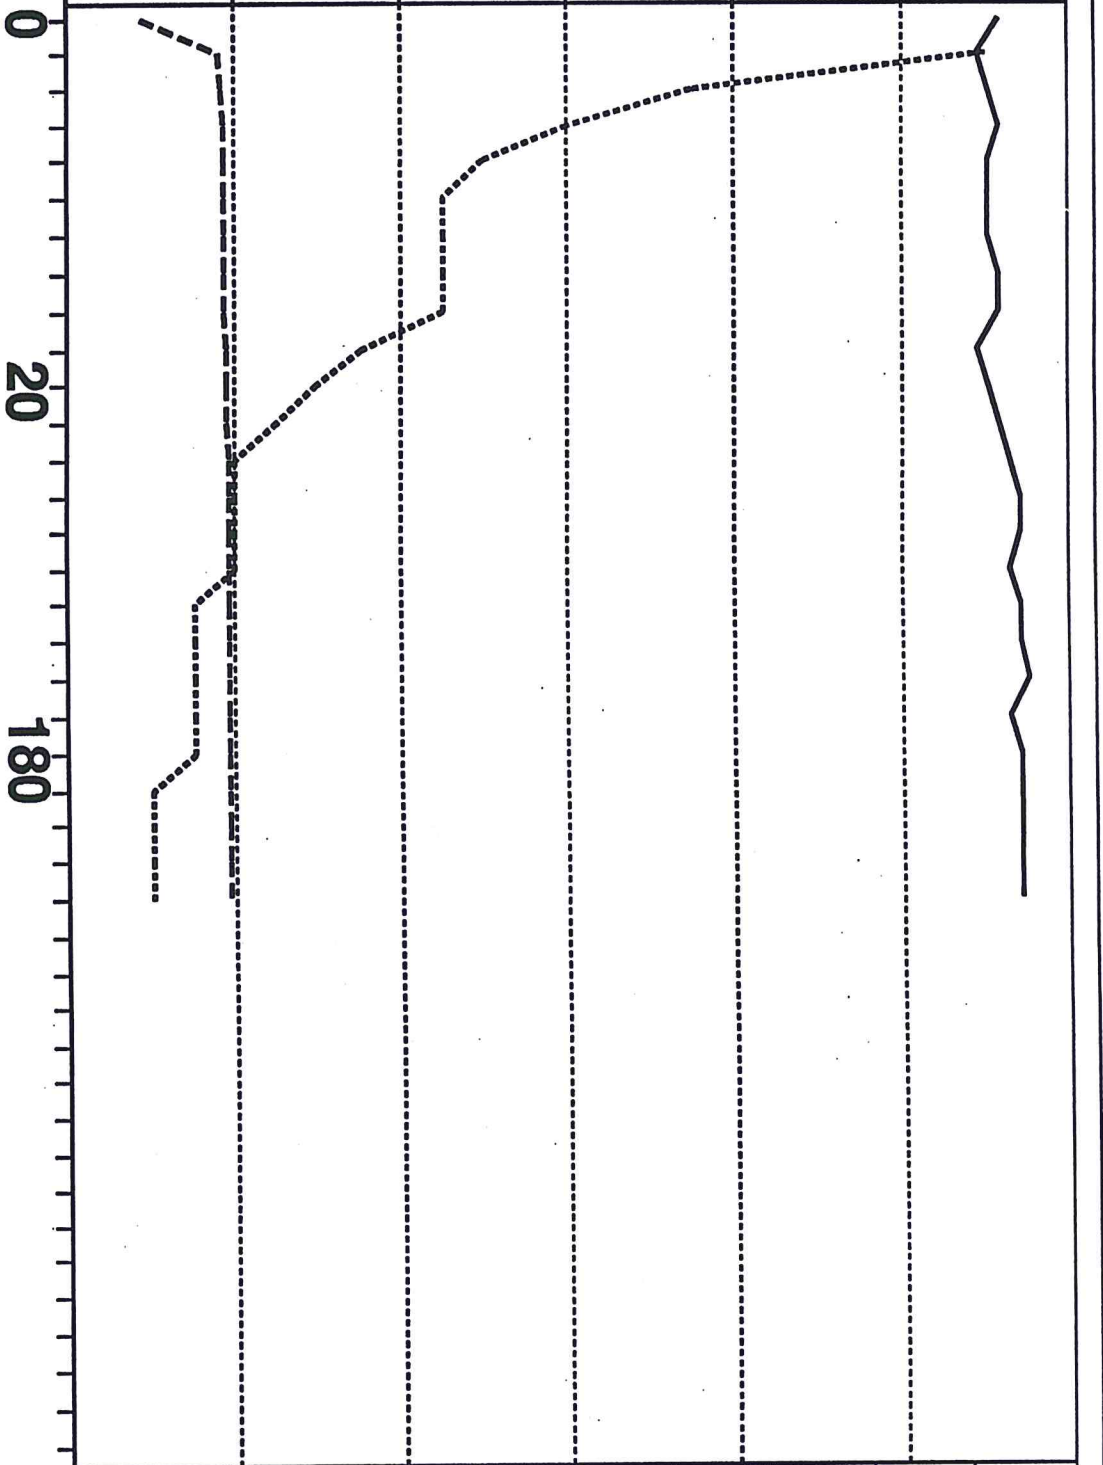

11  
10  
9  
8  
7  
6  
5  
4  
3  
2  
1

Flow (igpm) / Depth to water (meters)

Elapsed time since pump started (min)

..... Drawdown — Flow ..... DTW (m)